

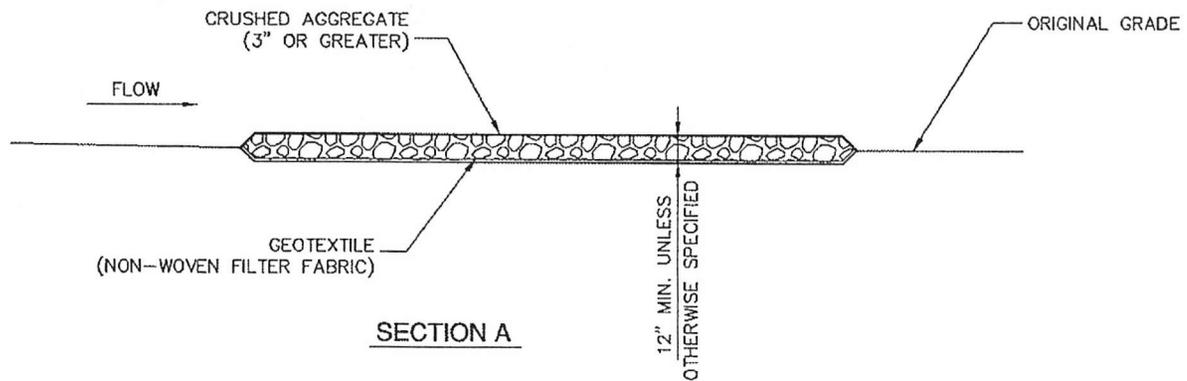


PLAN VIEW

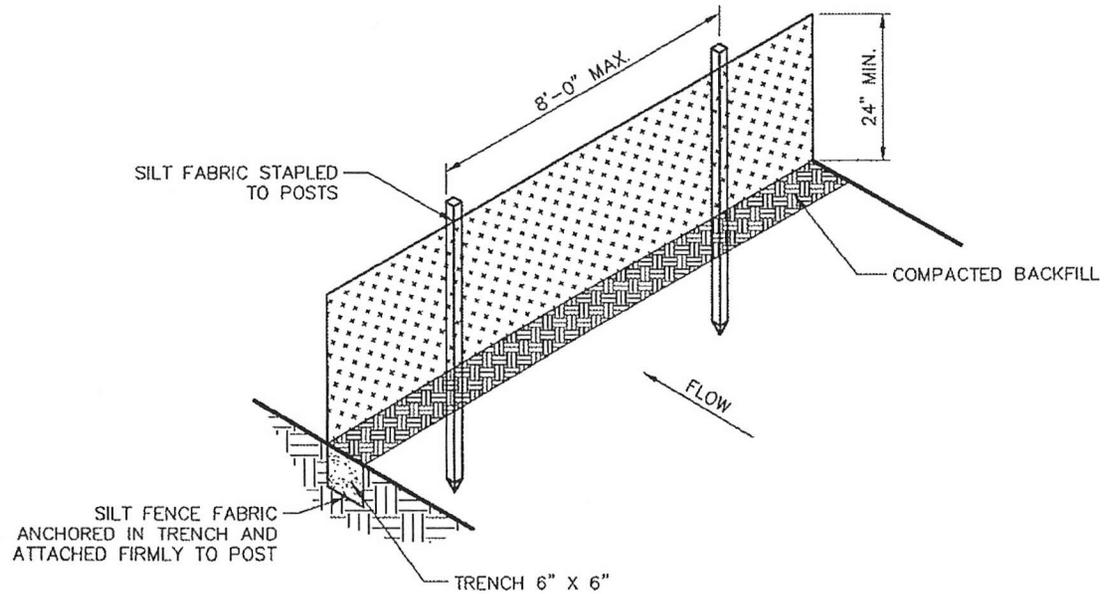

SECTION A

**STABILIZED CONSTRUCTION** (1)  
**ENTRANCE DETAIL** SCALE: N. T. S.

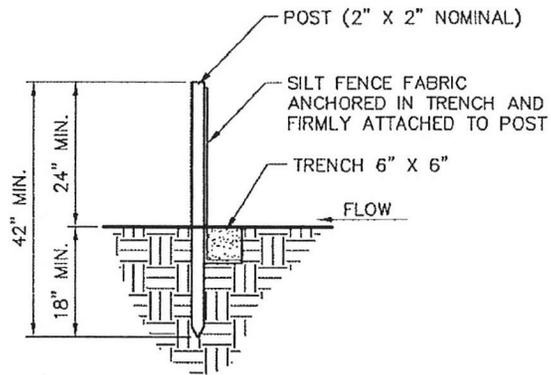


NOTES:

1. MINIMUM FILTER FABRIC HEIGHT SHALL BE 24".
2. POSTS FOR SILT FENCES SHALL BE METAL OR HARD WOOD WITH A MINIMUM LENGTH OF 36". WOOD POSTS SHALL HAVE A MINIMUM DIAMETER OR CROSS SECTION OF 2". METAL POSTS SHALL BE "STUDDED TEE" OR "U" TYPE WITH MINIMUM WEIGHT OF 1.33 LBS/FOOT.
3. DRIVE POSTS VERTICALLY INTO THE GROUND TO A MINIMUM DEPTH OF 18", AND EXCAVATE A TRENCH APPROXIMATELY 6" WIDE AND 6" DEEP ALONG THE LINE OF POSTS AND UPSLOPE FROM THE BARRIER. NO LESS THAN THE BOTTOM 1 FOOT OF THE FABRIC SHALL BE BURIED INTO THIS TRENCH.
4. THE FILTER FABRIC MATERIALS SHALL BE FASTENED SECURELY TO METAL OR WOOD POSTS USING WIRE TIES, OR TO THE WOOD POSTS WITH ¾" LONG #9 HEAVY DUTY STAPLES.
5. POSTS SHALL BE SPACED A MAXIMUM OF 8 FEET APART.

SILT FENCE DETAIL

2

SCALE: N. T. S.

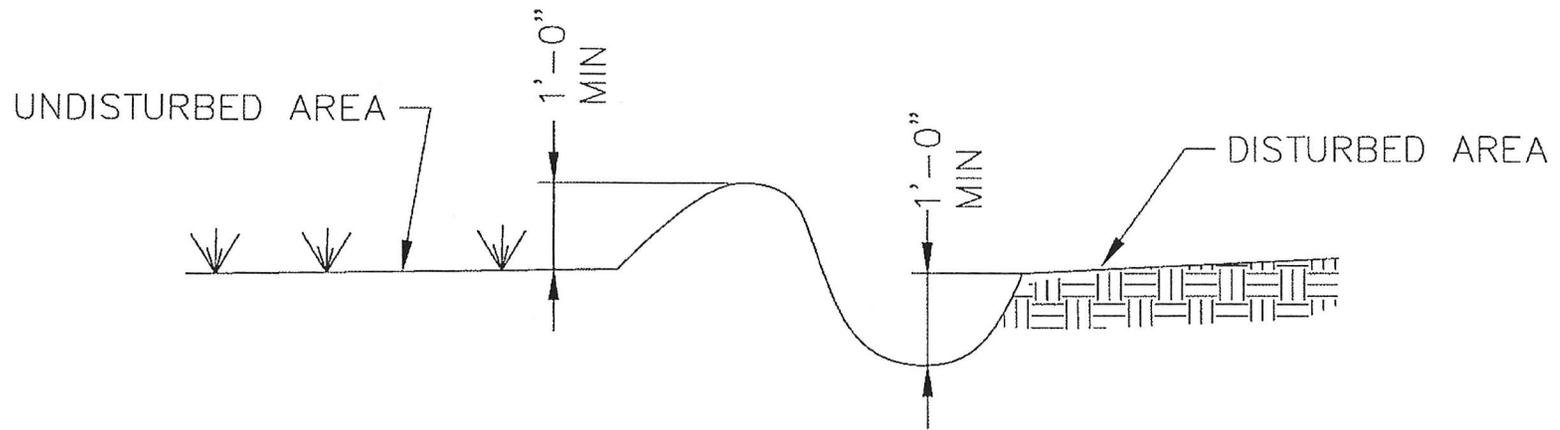

SWALE / BERM DETAIL (3)  
SCALE: N. T. S.

LATH & FLAGGING  
ON ALL SIDES

10' MIN

SANDBAG

BERM OR  
EXCAVATION

SANDBAG

10 MIL PLASTIC LINING

VARIABLES




3'

BERM OR  
EXCAVATION 2:1  
MAX SLOPE

SECTION A

10 MIL PLASTIC LINING

GRAVEL PAD- 2" TO  
4" ROCK 10' X 30'  
(AS REQUIRED)

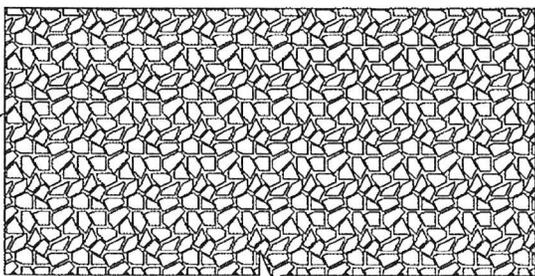

NOTES:


1. ACTUAL LAYOUT DETERMINED IN FIELD.
2. CONCRETE WASHOUT SIGN SHALL BE INSTALLED WITHIN 30 FT. OF THE TEMPORARY CONCRETE WASHOUT FACILITY.
3. WASHOUT NEEDS TO BE EMPTIED AND REPAIRED WHEN 75% OF STORAGE CAPACITY IS FILLED.
4. DEVELOPER/CONTRACTOR RESPONSIBLE FOR REMOVAL & PROPER DISPOSAL OF CONCRETE PRIOR TO FILING N.O.T

PLAN


CONCRETE WASHOUT DETAIL 4  
SCALE: N. T. S.




STORM WATER MANAGEMENT  
CONSTRUCTION DETAILS

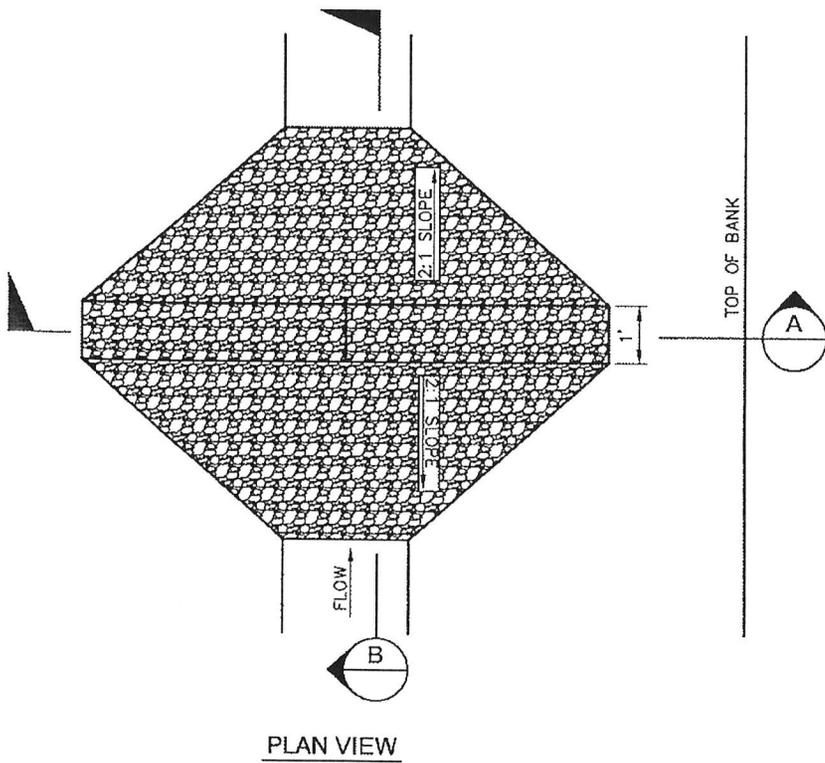



**DITCH ROCK CHECK DAM** (5)  
SCALE: N.T.S.

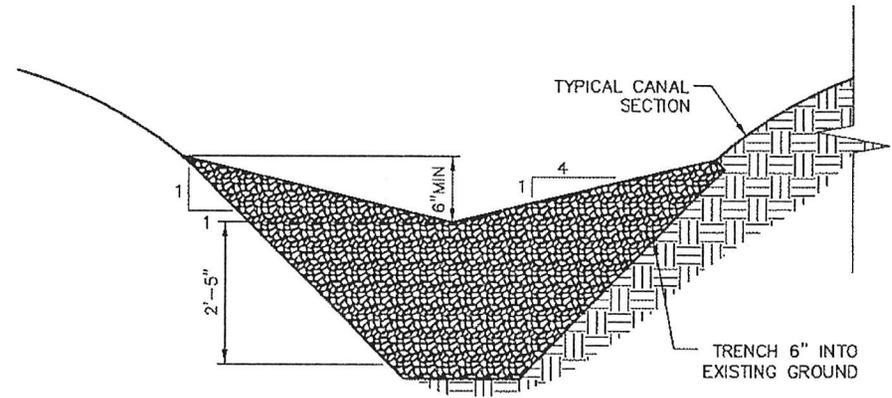

**SECTION A**  
SCALE: N.T.S.

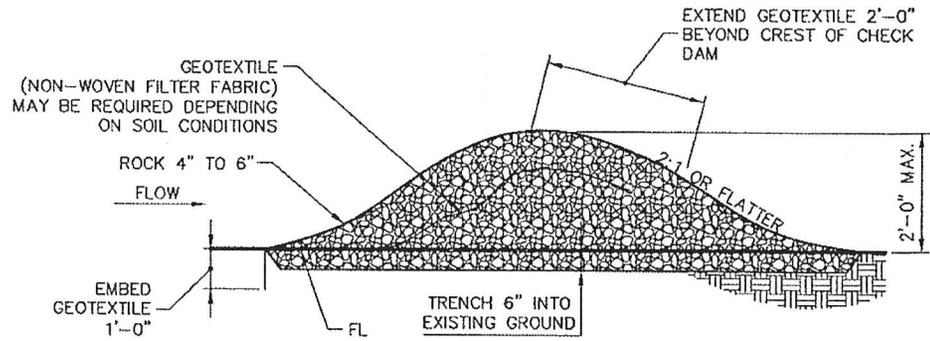

**SECTION B**  
SCALE: N.T.S.

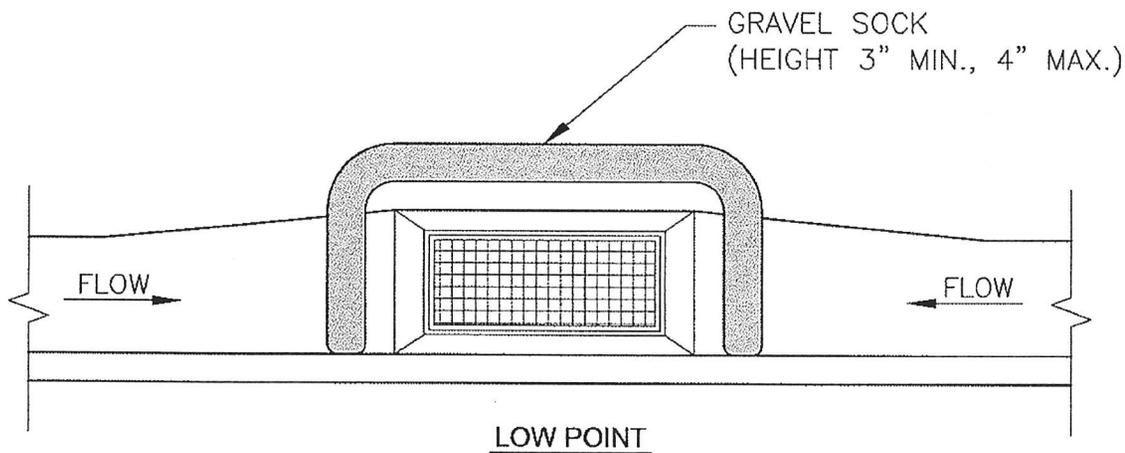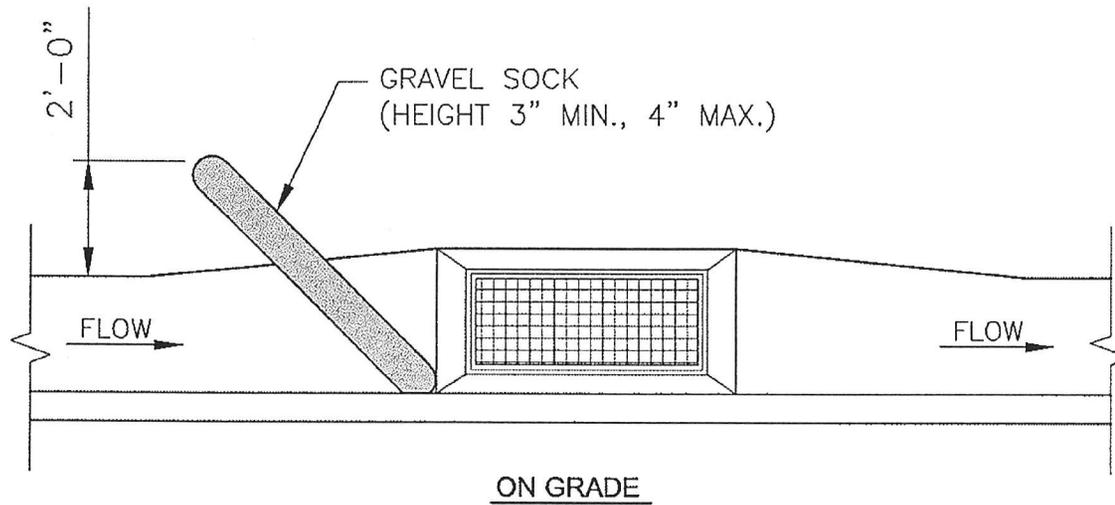

6 INLET PROTECTION DETAIL  
SCALE: N.T.S.